



State of New Jersey

DEPARTMENT OF ENVIRONMENTAL PROTECTION
Bureau of Nonpoint Pollution Control
Division of Water Quality
Post Office Box 029
Trenton, New Jersey 08625-029
609-633-7021 Fax: 609-984-2147
http://www.state.nj.us/dep/dwq/bnpc_home.htm

CHRIS CHRISTIE
Governor

KIM GUADAGNO
Lt. Governor

BOB MARTIN
Acting Commissioner


September 1, 2010

Derek M. Berg
Contech Construction Products, Inc.
200 Enterprise Drive
Scarborough, ME 04074

Re: Stormfilter by Contech Construction Products, Inc.

Dear Mr. Berg:

This is in response to your request for a determination regarding a new a bypass configuration for the Stormfilter. The use of the Stormfilter certification is limited to its use as an off-line manufactured treatment device. In such a configuration, the entire runoff from the water quality design storm is treated by the Stormfilter; however, any flows above the water quality design storm will not pass through the approved treatment system.

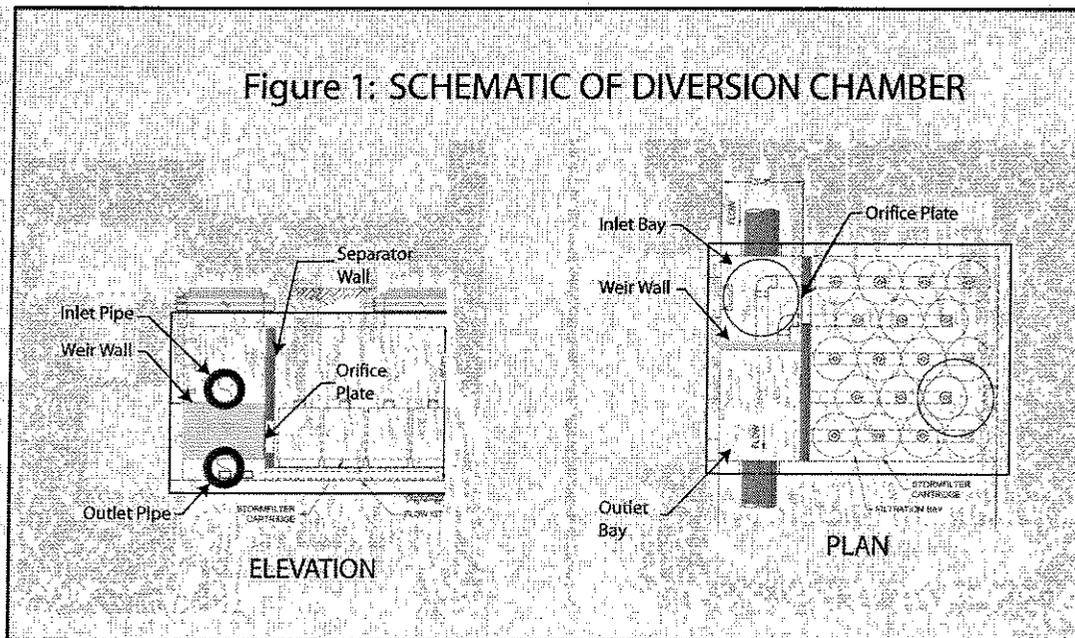

Based on the submitted information, the use of the chamber shown in Figure 1 qualifies as an off-line configuration provided that the elevation of the water quality design storm does not exceed the elevation of the weir wall, including any head necessary to ensure that the peak flow of the water quality design storm is diverted to the filter cartridges.

Please attach this to your previously issued certification letter for future reference. If you have any questions regarding this letter, please contact Ms. Sandra Blick at (609) 633-7021.

Sincerely,

A handwritten signature in black ink, appearing to read "Barry Chalofsky for B.C.", written in a cursive style.

Barry Chalofsky, P.P., Chief
Bureau of Nonpoint Pollution Control

c: Richard Magee, NJCAT
Tom Micai, DLUR