



KRAKEN FILTER DESIGN NOTES

KRAKEN FILTER TREATMENT CAPACITY VARIES BY CARTRIDGE COUNT AND LOCALLY APPROVED SURFACE AREA SPECIFIC TO FLOWRATE. PEAK CONVEYANCE CAPACITY TO BE CALCULATED BY ENGINEER OF RECORD.
 AN Ø6'-0" MANHOLE KRAKEN FILTER IS SHOWN WITH THE MAXIMUM NUMBER OF CARTRIDGES (18) AND IS AVAILABLE IN A LEFT INLET (AS SHOWN) OR A RIGHT INLET CONFIGURATION.
 ALL PARTS AND INTERNAL ASSEMBLY PROVIDED BY CONTECH UNLESS NOTED OTHERWISE.

CARTRIDGE HEIGHT	30"	20"	10"
RECOMMENDED HYDRAULIC DROP (H)	38.5"	28.5"	18.5"
SPECIFIC FLOW RATE (gpm/sf)	0.10	0.10	0.10
CARTRIDGE FLOW RATE (gpm)	17	10.6	4.9

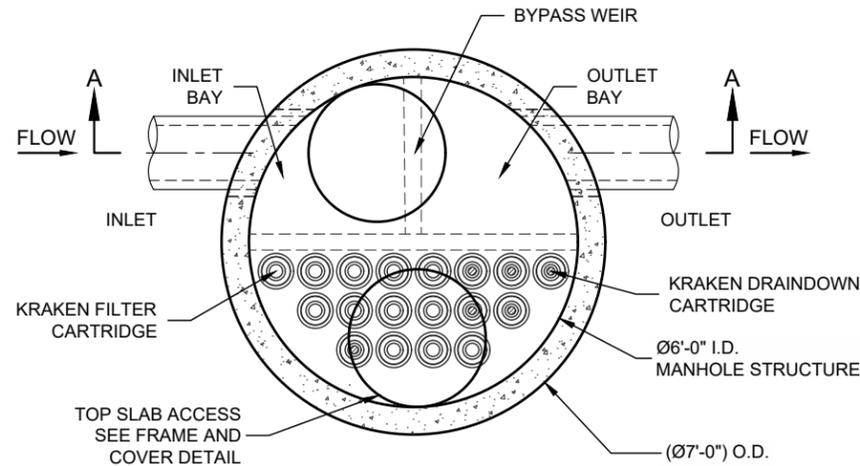


PLAN VIEW



FRAME AND GRATE

(24" x 24")
(NOT TO SCALE)




FRAME AND COVER

(30" ROUND)
(NOT TO SCALE)

SITE SPECIFIC DATA REQUIREMENTS

STRUCTURE ID				*
WATER QUALITY FLOW RATE (cfs)				*
PEAK FLOW RATE (cfs)				*
RETURN PERIOD OF PEAK FLOW (yrs)				*
CARTRIDGE HEIGHT (SEE TABLE ABOVE)				*
NUMBER OF CARTRIDGES REQUIRED				*
CARTRIDGE FLOW RATE				*
PIPE DATA:	I.E.	MATERIAL	DIAMETER	
INLET PIPE #1	*	*	*	
INLET PIPE #2	*	*	*	
OUTLET PIPE	*	*	*	
RIM ELEVATION				*
ANTI-FLOTATION BALLAST	WIDTH	HEIGHT		
	*	*		
NOTES/SPECIAL REQUIREMENTS:				
* PER ENGINEER OF RECORD				

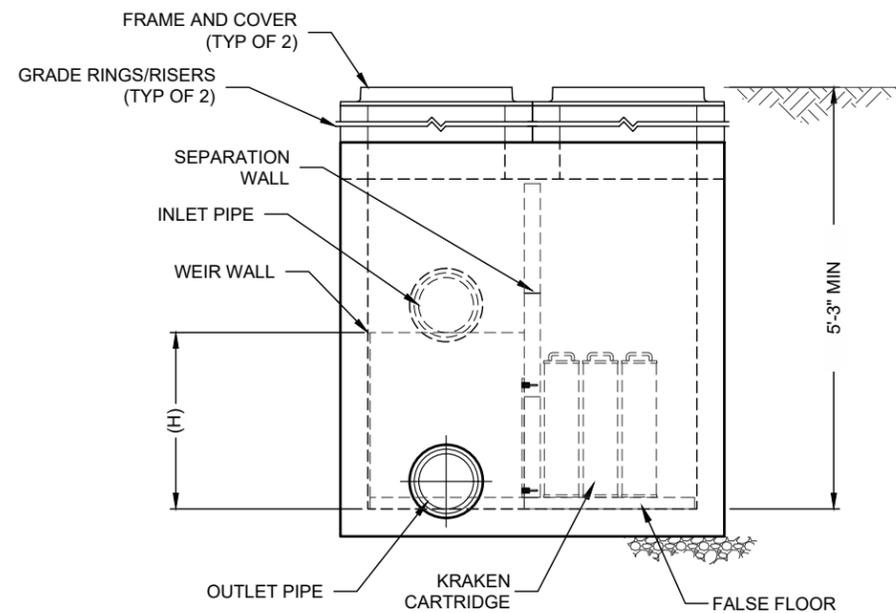

SECTION A-A

GENERAL NOTES

- CONTECH TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
- DIMENSIONS MARKED WITH () ARE REFERENCE DIMENSIONS. ACTUAL DIMENSIONS MAY VARY.
- FOR FABRICATION DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHTS, PLEASE CONTACT YOUR CONTECH REPRESENTATIVE. www.contechES.com
- KRAKEN FILTER WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING. CONTRACTOR TO CONFIRM STRUCTURE MEETS REQUIREMENTS OF PROJECT.
- STRUCTURE SHALL MEET AASHTO HS20 LOAD RATING, ASSUMING EARTH COVER OF 0' - 2' AND GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION. CASTINGS SHALL MEET AASHTO M306 AND BE CAST WITH THE CONTECH LOGO.

INSTALLATION NOTES

- ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE KRAKEN FILTER STRUCTURE.
- CONTRACTOR TO INSTALL JOINT SEALANT BETWEEN ALL SECTIONS AND ASSEMBLE STRUCTURE.
- CONTRACTOR TO PROVIDE, INSTALL, AND GROUT PIPES. MATCH OUTLET PIPE INVERT WITH OUTLET BAY FLOOR.
- CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION-RELATED EROSION RUNOFF.
- CONTRACTOR TO REMOVE THE TRANSFER OPENING COVER WHEN THE SYSTEM IS ACTIVATED.

THE KRAKEN
FOR PATENT INFORMATION, GO TO www.contechES.com/IP

CONTECH
ENGINEERED SOLUTIONS LLC
www.contechES.com

9100 Centre Pointe Dr., Suite 400, West Chester, OH 45069
800-338-1122 513-645-7000 513-645-7993 FAX

KFMH72
KRAKEN FILTER
STANDARD DETAIL