


VCL30 DESIGN NOTES

VCL30 RATED TREATMENT CAPACITY IS 110 GPM [6.93 l/s], OR PER LOCAL REGULATIONS. IF THE SITE CONDITIONS EXCEED RATED TREATMENT CAPACITY, AN UPSTREAM BYPASS STRUCTURE IS REQUIRED.

THE VORTCLAREX SYSTEM SHALL REMOVE ESSENTIALLY ALL FREE AND DISPERSED NON-EMULSIFIED OIL FROM THE WATER STREAM AND PRODUCE A DESIRED EFFLUENT BASED ON AN OIL DROPLET TYPICAL OF THE SITE.


THE VORTCLAREX SYSTEM SHALL BE DESIGNED IN ACCORDANCE WITH STOKES LAW AND API BULLETIN NO. 421.

THE STANDARD INLET/OUTLET CONFIGURATION IS SHOWN. FOR OTHER CONFIGURATION OPTIONS, PLEASE CONTACT YOUR CONTECH ENGINEERED SOLUTIONS LLC REPRESENTATIVE. www.ContechES.com

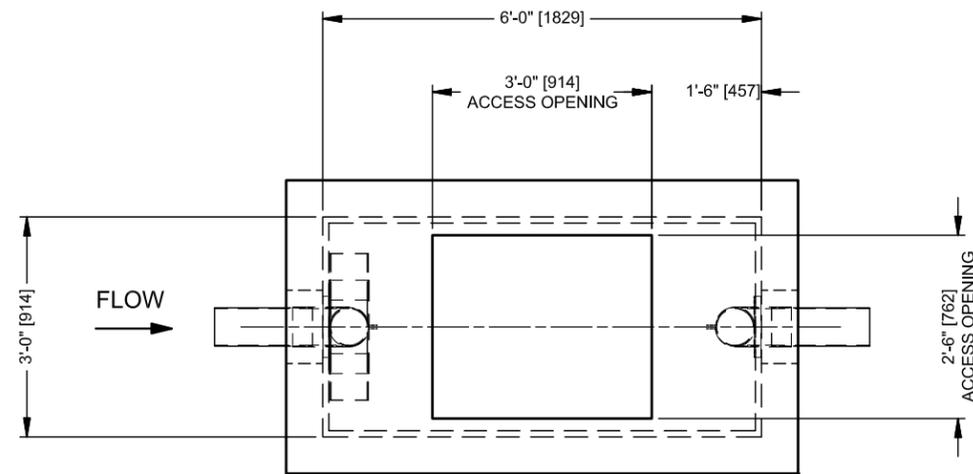


PLAN VIEW

(MEDIA NOT SHOWN FOR CLARITY)

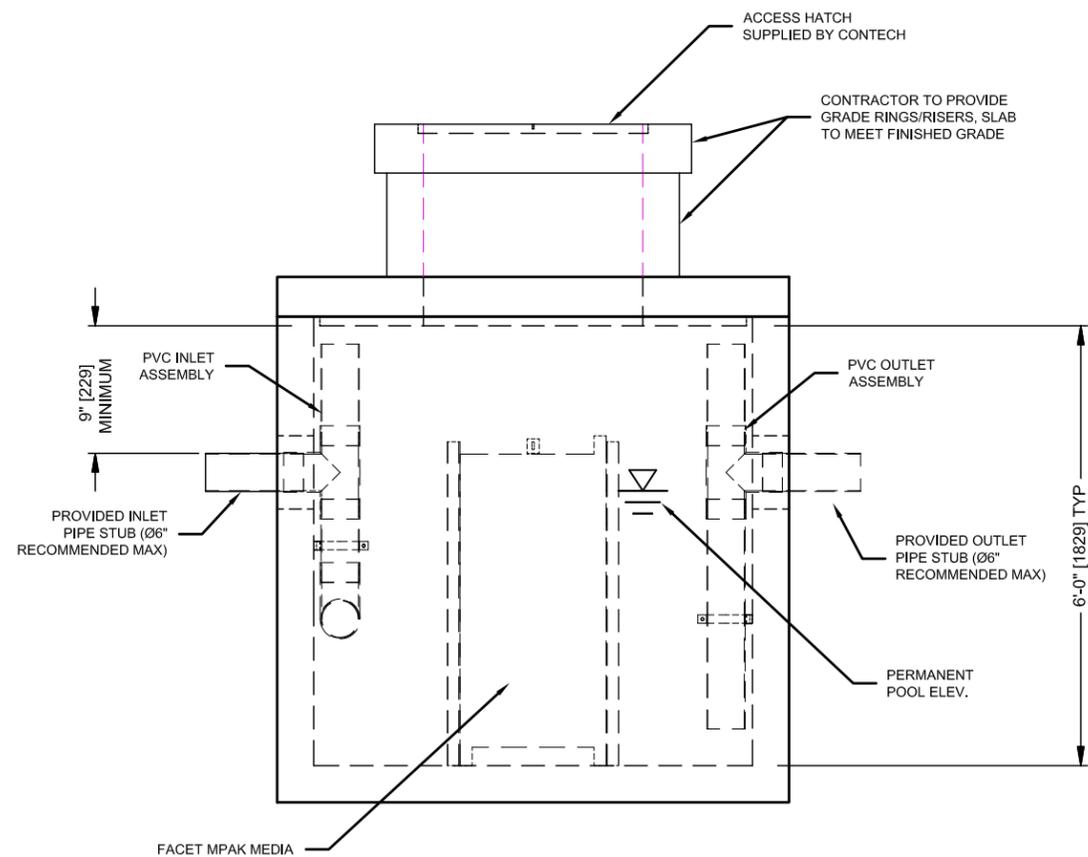

ELEVATION VIEW

VortClarex®

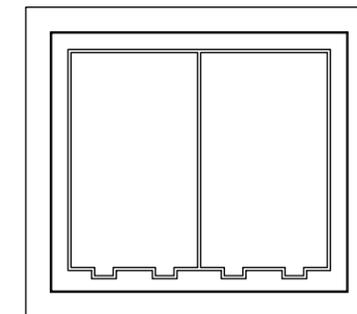

30" x 36" [762 x 914] ACCESS HATCH

(ACTUAL PRODUCT MAY VARY)
N.T.S.

GENERAL NOTES

1. CONTECH TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
2. FOR FABRICATION DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHT, PLEASE CONTACT YOUR CONTECH ENGINEERED SOLUTIONS LLC REPRESENTATIVE. www.ContechES.com
3. VORTCLAREX WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING. CONTRACTOR TO CONFIRM STRUCTURE MEETS REQUIREMENTS OF PROJECT.
4. STRUCTURE SHALL MEET AASHTO HS20 AND CASTINGS SHALL MEET AASHTO M306 LOAD RATING, ASSUMING GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION
5. INLET AND OUTLET PIPES MUST BE PERPENDICULAR TO THE VAULT TO ALLOW CONNECTION WITH PROVIDED PIPE STUBS.
6. FLOW LINE IN AND OUT OF THE VORTCLAREX IS RECOMMENDED TO BE AT THE SAME ELEVATION.
7. ALTERNATE UNITS ARE IN MILLIMETERS UNLESS NOTED OTHERWISE.

INSTALLATION NOTES

1. ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
2. CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE VORTCLAREX STRUCTURE (LIFTING CLUTCHES PROVIDED).
3. CONTRACTOR TO INSTALL JOINT SEALANT BETWEEN ALL STRUCTURE SECTIONS AND ASSEMBLE STRUCTURE.
4. CONTRACTOR TO PROVIDE AND INSTALL FERNCO, OR EQUIVALENT, COUPLER TO MATE EXISTING TRUNKLINE TO THE PROVIDED PIPE STUBS. MATCH PIPE INVERTS WITH ELEVATIONS SHOWN.

CONTECH
ENGINEERED SOLUTIONS LLC

www.ContechES.com
9025 Centre Pointe Dr., Suite 400, West Chester, OH 45069
800-338-1122 513-645-7000 513-645-7993 FAX

VORTCLAREX VCL30
STANDARD DETAIL